
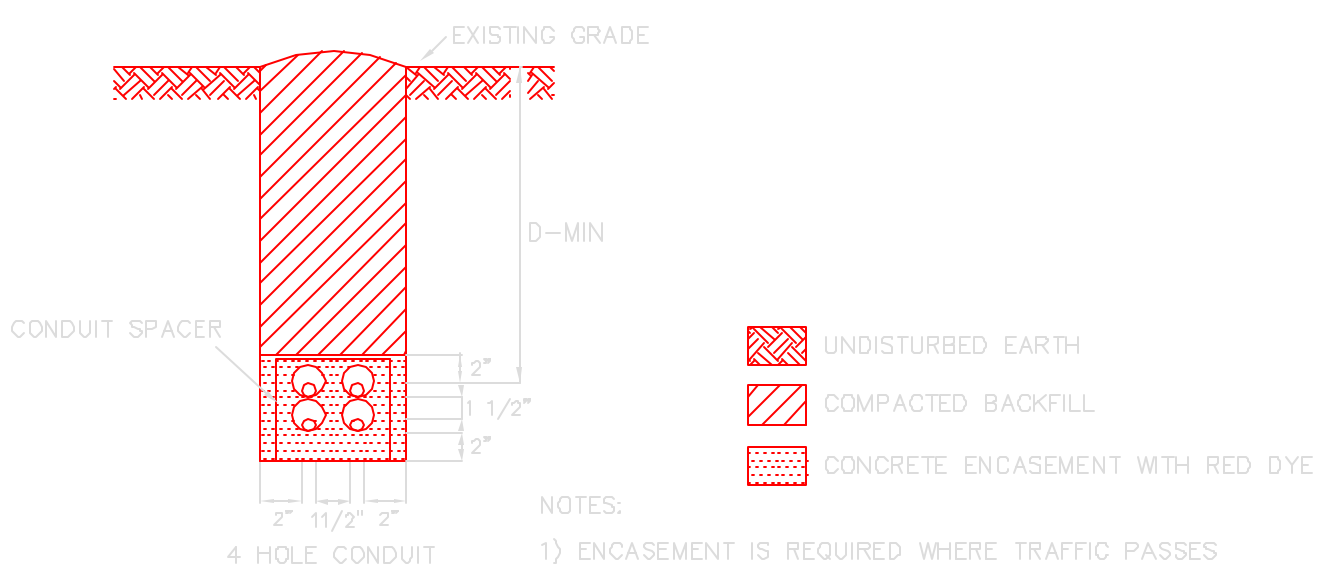


Rev. No.	Date	By	Appd.	Description
0	4/16/98	RWS	MEB	Original Drawing.
1	1/23/01	MED	MEB	Added note #1 & updated drawing border.
2	5/10/01	MED	MEB	Added conduit spacers and note # 2.

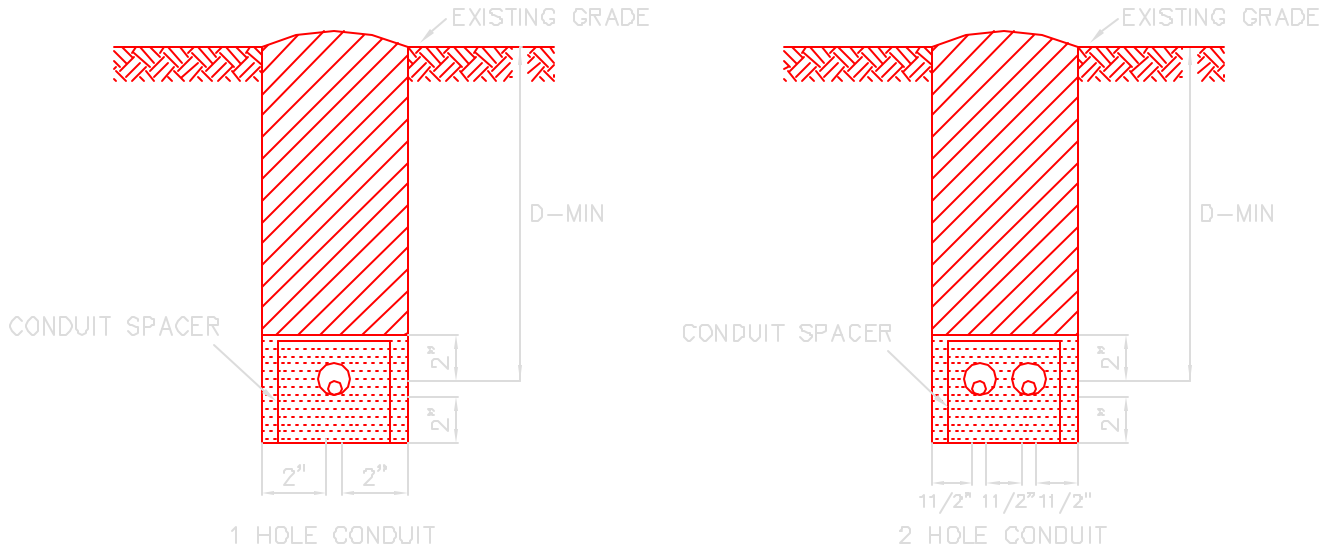

- NOTES:
- 1) ENCASEMENT IS REQUIRED WHERE TRAFFIC PASSES OVER CONDUIT, OR WHERE CITY OF OAK RIDGE ELECTRIC DEPARTMENT IDENTIFIES A NEED TO PROTECT THE CONDUIT SYSTEM.
  - 2) CONDUIT SPACERS ARE REQUIRED.
  - 3) THE DIMENSION "D" IS MEASURED FROM THE EXISTING GRADE TO THE TOP OF THE CONDUIT.

D = 24" MIN. FOR SECONDARY CABLES, 30" RECOMMENDED  
D = 36" MIN. FOR PRIMARY CABLES, 42" RECOMMENDED

<p><b>CORED</b></p> <p><b>SCALE: NTS</b></p> <p><b>RWS</b></p>	<p>Typical Trenches for</p> <p>Concrete Encased Ducts</p>	<p><b>DATE:</b> 4/16/98</p>
		<p><b>STANDARD NUMBER</b></p> <p>419.S01.R02</p> <p>UR2-CED</p>